


NOTICE


Safety Regulation Requirement

Separate Fuel and Oxygen Cylinders

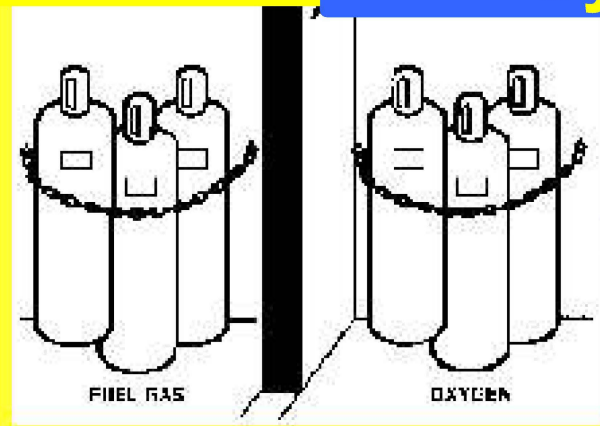

separate by
 $\frac{1}{2}$ hour rated fire barrier

or

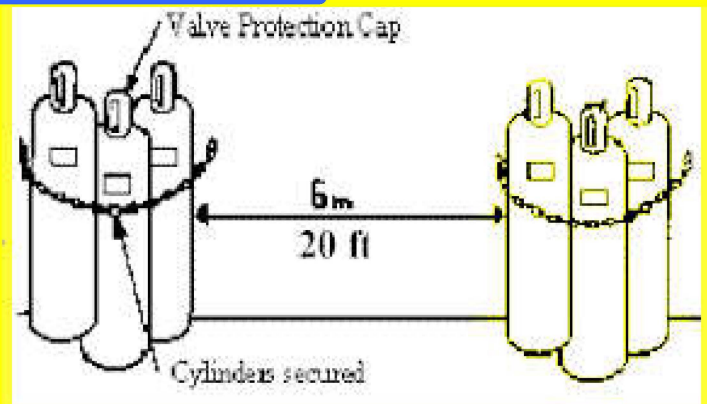

separate by
20 ft (6 m) distance